


Ameren Territory Environmental Disclosure Statement

MISO System Mix Sources of Electricity Supplied For the 12 months ending March 31, 2017

This chart shows how MISO distributed the resources from the System Mix to produce electricity in the MISO region

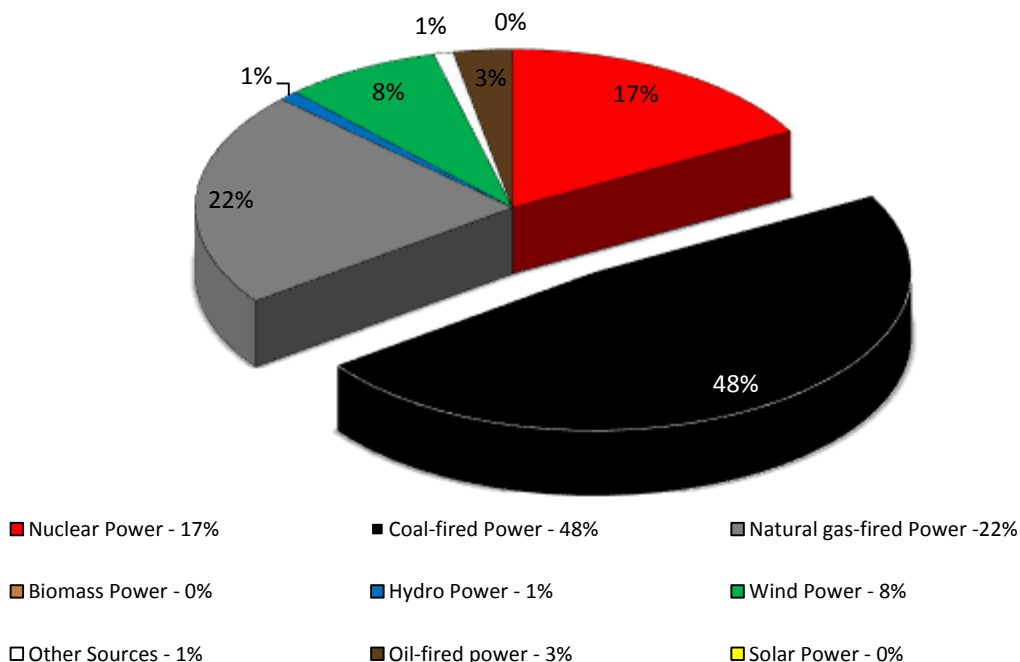

Average Amounts of Emissions and Amount of Nuclear Waste per 1,000 kilowatt-hours (kWh) Produced from Known Sources ¹ for the 12 months ending March 31, 2017

| Emission Type | Amount |
|--------------------------|--------|
| Carbon Dioxide | 1,360 |
| Nitrogen Dioxide | 0.73 |
| Sulfur Dioxide | 1.49 |
| High Level Nuclear Waste | 0.0010 |
| Low Level Nuclear Waste | 0.0002 |

Additional information on companies selling electrical power in Illinois may be found at the Illinois Commerce Commission's World Wide Web site www.icc.state.il.us. If you have questions, call Nordic Energy Services toll free at **877-808-1022**.

¹ One hundred percent of the total electricity supplied was purchased from other suppliers and the amount of nuclear waste attributable to producing this electricity is not known and is not included in this table.