


ComEd Territory Environmental Disclosure Statement

**PJM Residual Mix Sources of Electricity Supplied
For the 12 months ending September 30, 2015**

This chart shows how PJM distributed the resources from the Residual Mix to produce electricity in the PJM region

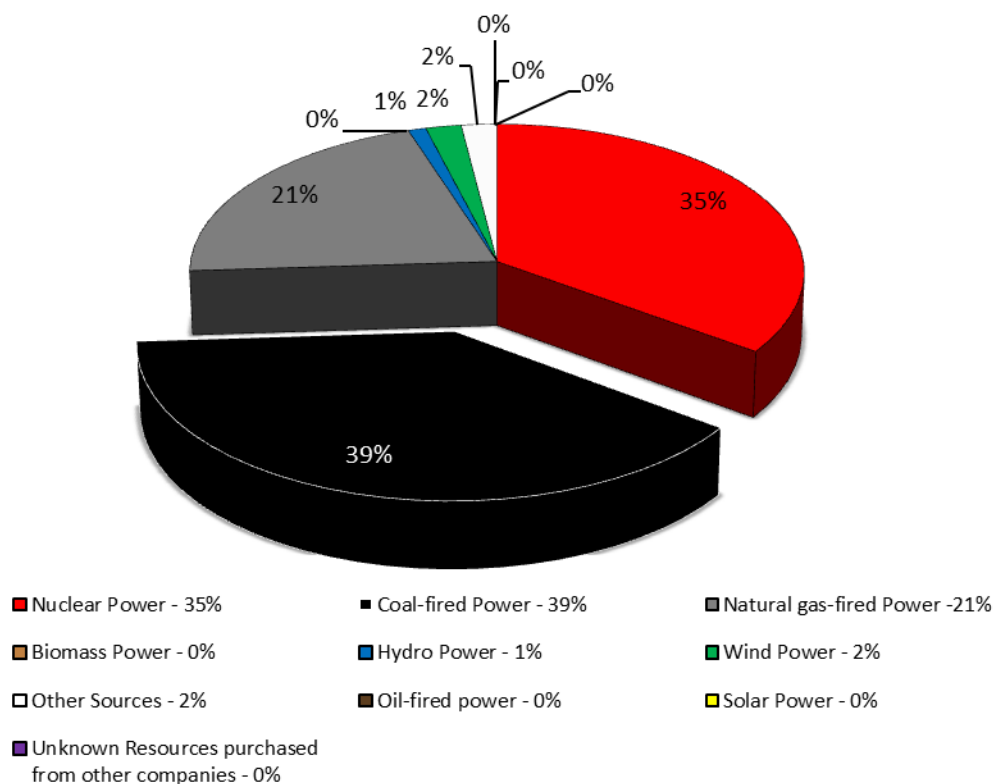

Average Amounts of Emissions and Amount of Nuclear Waste per 1,000 kilowatt-hours (kWh) Produced from Known Sources ¹ for the 12 months ending September 30, 2015

Emission Type	Amount
Carbon Dioxide	1,052 lbs.
Nitrogen Dioxide	.8128 lbs.
Sulfur Dioxide	1.8325 lbs.
High Level Nuclear Waste	0.006 lbs.
Low Level Nuclear Waste	0.0004 lbs.

The PJM System average emission levels are based on the PJM Generation Attributes Tracking System (GATS).

Additional information on companies selling electrical power in Illinois may be found at the Illinois Commerce Commission’s World Wide Web site www.icc.state.il.us. If you have questions, call Nordic Energy Services toll free at **877-808-1022**.

¹ One hundred percent of the total electricity supplied was purchased from other suppliers and the amount of nuclear waste attributable to producing this electricity is not known and is not included in this table.